


CAUTION

DETAIL NOT FOR USE ON 25 & 30-YEAR WARRANTY PROJECTS. ACCEPTABLE PIPE FLASHINGS SHALL CONFORM WITH **FB-8A** DETAIL OR REFER TO THERMOSET/THERMOPLASTIC UNIVERSAL DETAILS.

EPDM

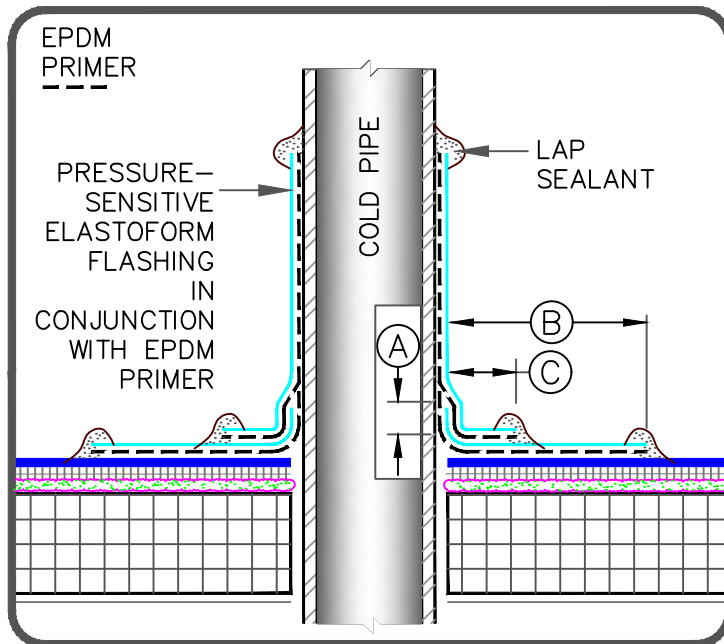


DIMENSIONS		mm	
(A)	1/2"	13	MIN.
(B)	3"	76	MIN.
(C)	1"	25	MIN.

NOTES:

1. REMOVE ALL LEAD AND OTHER FLASHING BEFORE INSTALLING FIELD-FABRICATED PIPE SEAL.
2. TEMPERATURE OF PIPE MUST NOT EXCEED 180°F (82°C).
3. PRIOR TO APPLYING PRESSURE-SENSITIVE ELASTOFORM FLASHING, APPLY EPDM PRIMER TO SPLICE AREAS.
4. MECHANICAL SECUREMENT IS REQUIRED AROUND ALL PIPES GREATER THAN 18" (457mm) IN DIAMETER.
5. IN COLDER TEMPERATURES A HEAT GUN MUST BE USED WHEN FORMING PRESSURE-SENSITIVE ELASTOFORM FLASHING.
6. REFER TO EPDM UNIVERSAL DETAILS FOR HOT STACK, STEEL TUBING & FLEXIBLE PIPE PENETRATIONS.


TPO/PVC/KEE HP

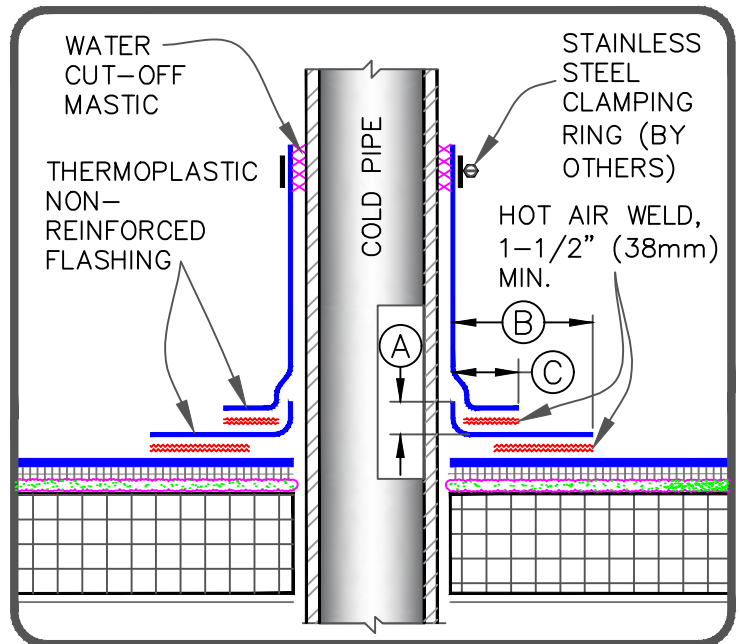

DIMENSIONS		mm	
(A)	1/2"	13	MIN.
(B)	1-1/2"	38	TO
	2"	51	
(C)	1"	25	MIN.

NOTES:

1. REMOVE ALL LEAD AND OTHER FLASHING BEFORE INSTALLING FIELD FABRICATED PIPE SEAL.
2. TEMPERATURE OF THE PIPE PENETRATION MUST NOT EXCEED 140°F (60°C) WHEN USING PVC OR KEE HP AND 160°F (71°C) WHEN USING TPO FLASHING.
3. APPLY HEAT TO FLASHING AND FORM BY HAND PRIOR TO HOT AIR WELDING
4. MECHANICAL SECUREMENT IS REQUIRED AROUND ALL PIPES GREATER THAN 18" (457mm) IN DIAMETER.
5. REFER TO THERMOPLASTIC UNIVERSAL DETAILS FOR HOT STACK, STEEL TUBING & FLEXIBLE PENETRATIONS.

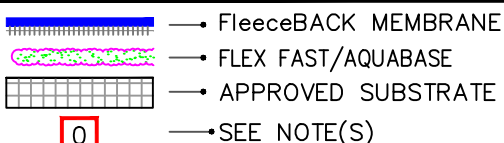

FIELD FABRICATED PIPE FLASHING

For additional information, refer to Specifications



DETAIL NO.

FB-8B

FLEECEBACK ADHERED